



**Q1 MEDIUM CUT OUT DETAILS 1/1**

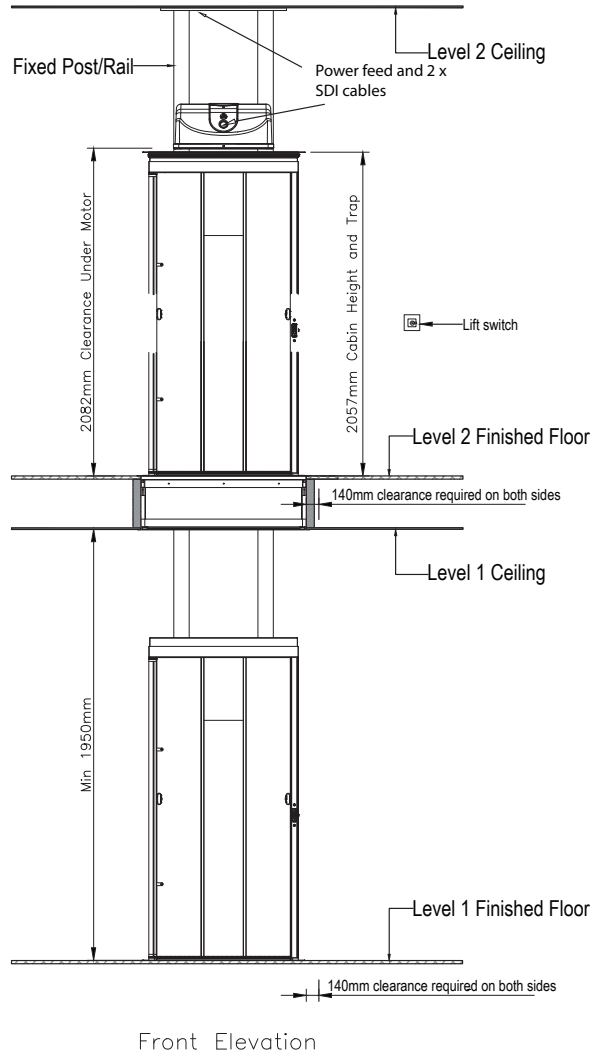

Note: Builder to ensure solid fixing points above ceiling available

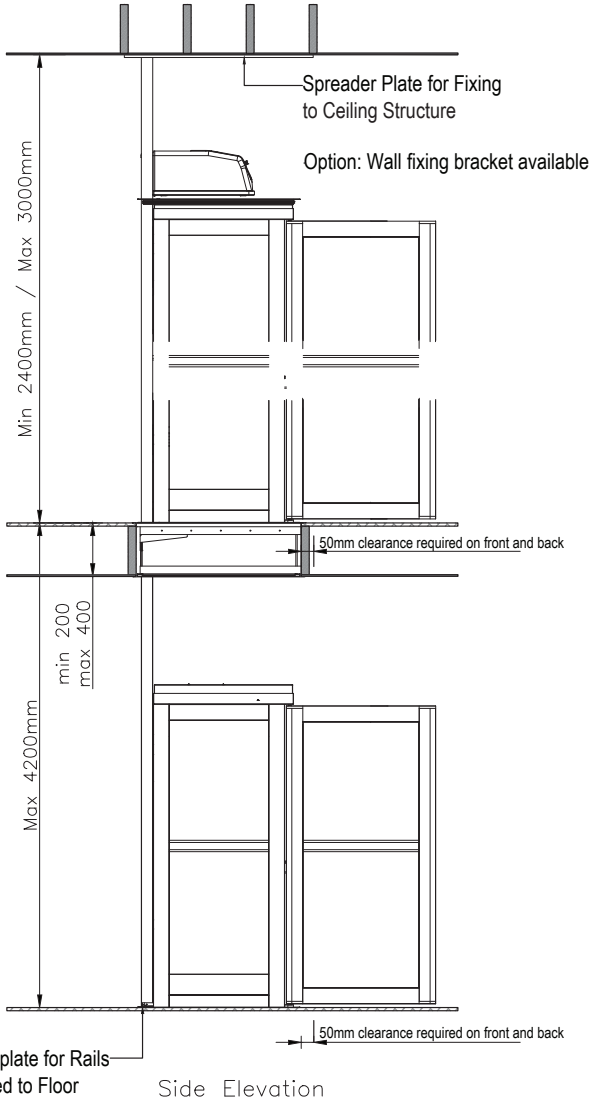

Electrical Requirements:


Provide a dedicated 20-amp circuit fed to a 2 pole 32-amp switch. The switch is to be located on the first floor readily accessible in proximity to the lift.

From switch to termination point, run red, black and earth + 2x 2.5mm SDI cables with 2m tail

Termination point

- Wall Bracket - rear of motor position
- Ceiling Board- tail to the ceiling space above the lift

See link for more information, client responsibilities & photos - [Click Here](#)

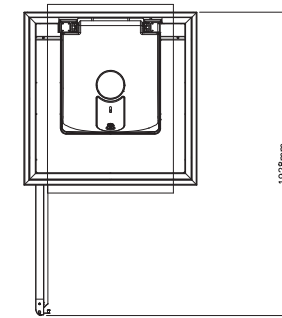

Note: Right Hand Hinge (RHH) Available

**Q1 ELEVATIONS & ELECTRICAL - MEDIUM 2/2**

California  
 143 E 16th Street  
 Costa Mesa, CA 92627

Sydney  
 1/75 Corish Circle  
 Eastgardens 2036  
 P 02 9666 3939

Melbourne  
 1/1 Belgium Avenue  
 Richmond 3121  
 P 03 9421 4222

Brisbane  
 4/300 Cullen Avenue East, Eagle  
 Farm  
 P 07 3014 0633

Perth  
 15/75 Robinson Avenue,  
 Belmont  
 P 08 9460 0666